

Exova  
2395 Speakman Dr.  
Mississauga  
Ontario  
Canada  
L5K 1B3

T: +1 (905) 822-4111  
F: +1 (905) 823-1446  
E: sales@exova.com  
W: www.exova.com



Testing. Advising. Assuring.

**PERFORMANCE EVALUATION OF THE CARTER ARCHITECTURAL PANELS INC.,  
“EVO™ RIVETLESS™ PANEL SYSTEM”  
IN ACCORDANCE WITH AAMA 508-07 FOR PRESSURE EQUALIZATION  
BEHAVIOR & WATER PENETRATION RESISTANCE**

Report to:	<b>Carter Architectural Panels Inc.</b> 221 E. Willis Road “A” Unit 18 Chandler, AZ 85286
Attention: cc.:	Mr. Joel McKinley Mr. Bruce Bourne
Telephone: E-mail:	(408) 899 3955 JMcKinley@CarterPanels.com BBourne@ CarterPanels.com
Report No.:	16-06-M0171-2DR 7 Pages, 3 Appendices
Proposal No.:	16-006-438721
Date:	July 7, 2016

## 1.0 INTRODUCTION

Exova was retained to evaluate the “EVO™ RIVETLESS™ Panel System” exterior wall panel system in accordance with AAMA 508-07 for pressure equalization behavior and water penetration resistance as outlined in Proposal number 16-006-438721.

Upon receipt, the specimen was assigned the following Exova Specimen Number:

**Client Specimen Description**

EVO™ RIVETLESS™ Panel System  
 (“T” Panel Scheme / 3 panels, not individually pressure isolated)

**Exova Specimen No.**

14-06-M0187 / 14-06-M0363

*Note: The ACM used in the “EVO™ RIVETLESS™ Panel System” by Carter Architectural Panel Inc., is “Iarson by ALUCOIL.” A complete bill-of-materials and details for the specimen identified above is located in Appendix A.*

## 2.0 PROCEDURE

Test Description	Test Method
Voluntary Test Method and Specification for Pressure Equalized Rain Screen Wall Cladding Systems – Pressure Equalization Behaviour	AAMA 508-07, Section 5.5 – Referencing ASTM E1233 (Modified)
Voluntary Test Method and Specification for Pressure Equalized Rain Screen Wall Cladding Systems – Water Penetration Resistance	AAMA 508-07, Section 5.6 – Referencing ASTM E331
Voluntary Test Method and Specification for Pressure Equalized Rain Screen Wall Cladding Systems – Dynamic Water Test	AAMA 508-07, Section 5.7 – Referencing AAMA 501.1-05

Note: SI units are the primary units of measure. The original testing performed in accordance with AAMA 508-07, Sections 5.5, 5.6 were conducted as outlined in Exova Project No.: 14-06-M0187 on the same specimen referenced in this report.

**Test Wall Section Description & Details:**

The back-up test wall section (air / water barrier) was constructed in an Exova test frame as per the detail drawing below in accordance with AAMA 508-07, Section 5.0:

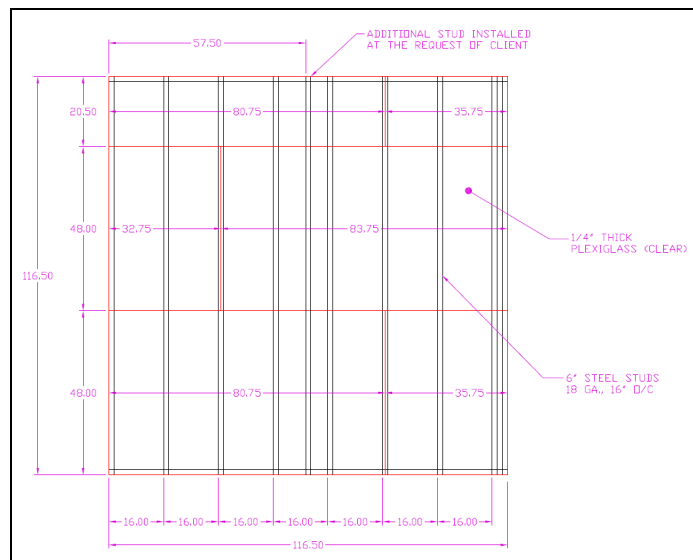


Figure 1 – Back-up Test Wall Framing Construction

Upon completion of the back-up wall, the Plexiglas joints and screw-heads were sealed to ensure the assembly was air-tight. After the air leakage validation for tightness was completed, as prescribed by AAMA 508-07, Section 5.2.2 & Figure 1A, three (3) mm diameter holes were introduced equally spaced 150 mm above horizontal seams and above the base of the mock-up in order for the air / water barrier to have an air leakage rate of 0.6 L/s·m<sup>2</sup>.

The application of the cladding system on the test back-up wall was performed by Carter Fabricating Inc. authorized personnel on June 22, 2014. As permitted by AAMA 508-07, Note 5, the perimeter of the specimen was sealed to the fixture that the wall section was constructed into. No drainage/vent holes or critical areas of the specimen that would be affected by water infiltration / drainage or differential pressure were obstructed.

Using the procedure outlined in AAMA 508-07, Section 5.5, the pressure cycling tests were conducted as specified in ASTM E1233. However, ASTM E1233 was modified to incorporate a positive pressure from 240 Pa to 1200 Pa to 240 Pa based on a maximum average of three seconds for 100 cycles as per AAMA 508-07.

Upon completion of the pressure equalization behavior test, the AAMA 508-07, Section 5.6, water penetration test at 300 Pa for fifteen minutes was conducted.

**Test Date: July 10, 2014 (for above)**

Upon completion of the static water penetration test as outlined in AAMA 508-07, Section 5.6, testing was conducted in accordance with AAMA 508-07, Section 5.7 referencing AAMA 501.1-05 at 300 Pa.

**Test Date: January 23, 2015 (AAMA 508-07, Section 5.7 / AAMA 501.1-05)**

### 3.0 RESULTS

Table 1 – Pressure Equalization Behavior Analysis Exova Specimen Number: 14-06-M0187 / 14-06-M0363					
Compartment Tested	Maximum External Gust Pressure of Pulse (Pa)	Maximum Cavity Pressure of Pulse (Pa)	Requirements		Comments
			Pressure Differential	Maximum Time Shift of Pulse	
Primary Compartment	1178	1132	Pressure differential on rain screen cladding shall not exceed 50% of maximum wind gust pressure	< 0.08 seconds	Meets Requirement

Pressure equalization graphs are located in Figures 2 (Page 4)

- Air Leakage of Back-Up Wall (air / water barrier): **0.57 L/sm<sup>2</sup>**
- Ratio of cavity volume to vent area (Upper Panels): **664 m<sup>3</sup> / m<sup>2</sup>**
- Ratio of cavity volume to vent area (Lower Panel): **680 m<sup>3</sup> / m<sup>2</sup>**

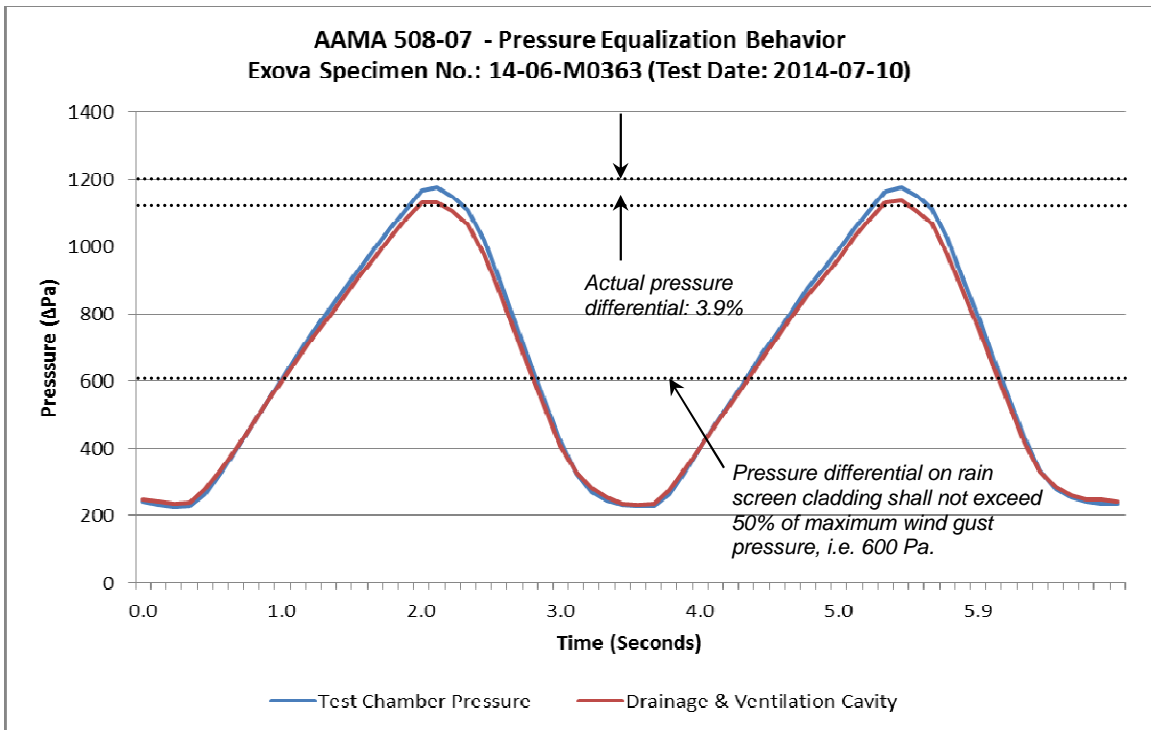


Figure 2 – Pressure Equalization Behavior

<b>Table 2 – Static Water Penetration Resistance</b> <b>AAMA 508-07, Section 5.6, Referencing ASTM E331-00 (2009)</b> <b>Exova Specimen Number: 14-06-M0187 / 14-06-M0363</b>			
Test Pressure (Pa)	Requirements	Results	Comments
300 Pa (15-Minutes)	<p>All water that penetrates the exterior rain screen cladding shall be controlled and drained to the exterior. All water that contacts the air / water barrier shall be visually observed and recorded:</p> <p>a) Water mist or droplets on the air/water barrier surface; and/or</p> <p>b) Water in continuous stream on the air/water barrier surface.</p> <p>Failure shall be defined as water mist or water droplets appearing in excess of 5% of the air/water barrier surface, or continuous streaming at any location on the air/water barrier.</p>	<p>Water mist and/or droplets were observed. No continuous streaming was observed.</p> <p>1.31 % of air/water barrier surface area had water misting and / or water droplets.</p>	<p><b>Meets Requirement</b></p>

Table 3 – Support Wall Deflection Measurements AAMA 508-07, Section 5.8, Referencing ASTM E330 <sup>(2)</sup> Exova Specimen Number: 14-06-M0187 / 14-06-M0363			
Test	Requirements	Test Results	Comment
Uniform Load Deflection (Clause 5.1.2)	<p><b>ASTM E330 Modified:</b> +/- 1,200 Pa</p> <p><b>Requirements:</b> - No permanent damage - Report Support Wall Deflection</p>	<p>Stud Length (L) = 2,950 mm Allowable (L/180) = 16.4 mm</p> <p>Net Deflection at Design Pressure:</p> <p>+ 1,200 Pa = -2.4 mm - 1,200 Pa = 3.0 mm</p> <p>- No Permanent Damage Observed</p>	<p><b>Meets Requirements</b></p> <p>L/180 @ 1,200 Pa</p>

(1) 1,200 Pa = 44.4 m/s (or 100 mph / 160 km/h). Calculation based on the Enswiler formula, where  $P = 0.613 \cdot V^2$ , V is m/s & P is N/m<sup>2</sup>

(2) AAMA 508-07, Section 5.8 states: "When testing the actual air/water barrier for a project specific system, perform static structural performance test ASTM E330 at 0.5, 1.0 and 1.5 times the specified positive and negative design pressures." As the testing outlined in this report was not for a project specific system, a design pressure was not outlined. However, Exova performed structural testing of the AAMA 508-07 system in accordance with ASTM E330-00 to a pressure of ±1,200 Pa (160 km/h) for informational purposes.

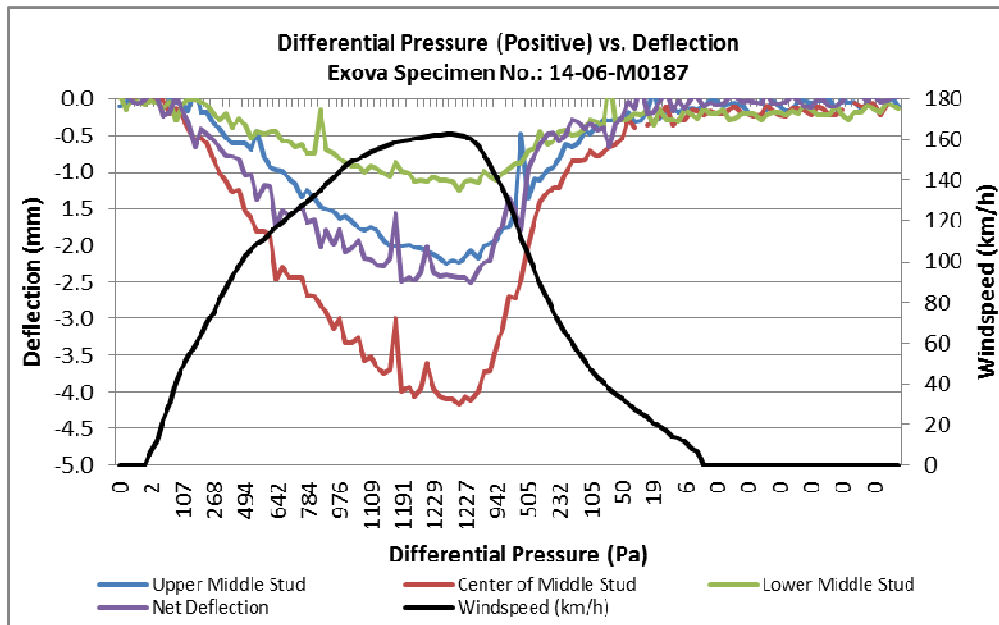


Figure 3 – Differential Pressure (Positive) vs. Deflection, ASTM E330

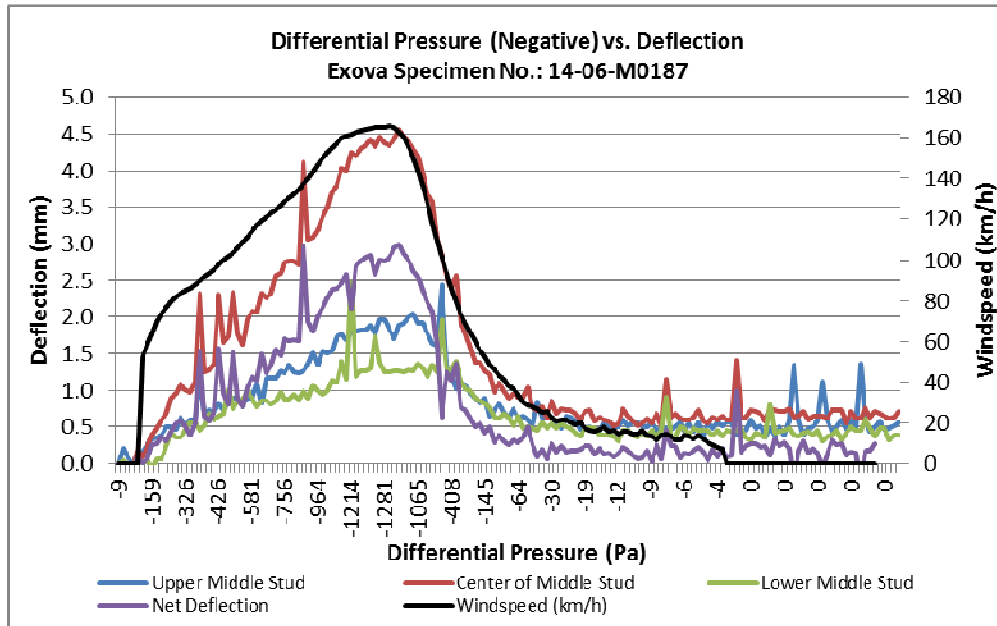


Figure 4 – Differential Pressure (Negative) vs. Deflection, ASTM E330

Table 4 – Water Penetration Resistance Using Dynamic Pressure AAMA 501.1-05, Section 5.7, Referencing AAMA 501.1-05 Exova Specimen Number: 14-06-M0187 / 14-06-M0363			
Test Pressure (Pa)	Requirements	Test Results	Comment
300 Pa <sup>(2)</sup> (15-Minutes)	<p>All water that penetrates the exterior rain screen cladding shall be controlled and drained to the exterior. All water that contacts the air / water barrier shall be visually observed and recorded:</p> <p>a) Water mist or droplets on the air/water barrier surface; and/or b) Water in continuous stream on the air/water barrier surface.</p> <p>Failure shall be defined as water mist or water droplets appearing in excess of 5% of the air/water barrier surface, or continuous streaming at any location on the air/water barrier.</p>	<p>Water mist and/or droplets were observed.</p> <p>1.39 % of air/water barrier surface area had water misting and / or water droplets.</p> <p>All water that penetrated the exterior rain screen cladding was controlled and drained to the exterior with no continuous streaming observed.</p>	<b>Meets Requirements</b>

<sup>(2)</sup> 300 Pa = 22.1 m/s (or 50 mph / 80.5 km/h). Calculation based on the Enswiler formula, where  $P = 0.613 \cdot V^2$ , V is m/s & P is N/m<sup>2</sup>

**Outdoor Conditions during Test (January 23, 2015):**

Temperature: 1.3 °C  
 Relative Humidity: 59 %RH  
 Barometric Pressure: 99.56 kPa (Environment Canada, Toronto Pearson International Airport)

#### 4.0 SYSTEM MODIFICATIONS

No modifications were made to the system as shown respectively in Appendix A.

#### 5.0 DISCUSSION

The "EVO™ RIVETLESS™ Panel System" identified in this report met the requirements of AAMA 508-07 for cavity pressure differential, time shift of pulse and static and dynamic water penetration.

The system contained a cavity volume to vent area ratio of 664 m<sup>3</sup>/m<sup>2</sup> (Upper Panels) & 680 m<sup>3</sup>/m<sup>2</sup> (Lower Panel) and used two Ø9.5 mm drain/vent holes per upper panel and four Ø9.5 mm drain/vent holes on the lower panel.

This report is not intended as a comprehensive evaluation of the system regarding performance and application to specific buildings.


#### 6.0 REPORT REVISION HISTORY


<u>Date:</u>	<u>Revision:</u>	<u>Comments:</u>
2016-July-7	Original Document	N/A

*Note: This report is reissued in the name of Carter Architectural Panels Inc., through written authorization from Carter Fabricating Inc. to whom the original report was rendered. The original tested specimen was manufactured and assembled by Carter Fabricating Inc. as outlined in Exova Report No.: 14-06-M0363 (dated: February 7, 2015).*

Reported by:

Authorized by:

  
Sunny Ling, CET. Ext.11412  
Supervisor, Building Systems  
Products Testing Division

  
Jordan M. Church, B.Tech, Technologist, Ext. 11546  
Operations & Technical Manager, Products Division  
Product Testing Division

*This report and service are covered under Exova Canada Inc's. Standard Terms and Conditions of Contract which may be found on our company's website [www.exova.com](http://www.exova.com), or by calling 1-866-263-9268*

**APPENDIX A**

Specimen Bill of Materials and Drawings

(4 Pages)



**Bill of Materials (Provided by the Proponent):**

- 2 - "EVO™" RIVETLESS™ PANELS (PANEL SIZE IS 57.25" X 57.25")
- 1 - "EVO™" RIVETLESS™ PANEL (PANEL SIZE IS 57.25" X 115.25")

- EACH PANEL CONSISTED OF 4MM LARSON ACM
- # 8 SELF DRILLING SCREWS ON 16" MIN CENTERS USED TO FASTEN THE PERIMETER PANEL EXTRUSION TO THE 4MM LARSON ACM
- WEEP HOLES @ .375" DIAMETER ON 20" CENTERS WITH FOAM BUG SCREEN BACKING
- CUSTOM DIE PERIMETER EXTRUSION AROUND THE ENTIRE PANEL PERIMETER (6061 T6 ALUMINUM CUSTOM PROFILE)
- 3" MID-CLIPS (MOUNTING CLIPS 6061 T6 ALUMINUM CUSTOM DIE PROFILE) EACH SCREWED TO THE PERIMETER EXTRUSION ON 16 INCH CENTERS WITH 2 #6 X .375" SCREWS. AND THEN AFFIXED TO THE SUBSTRATE OR Z-GIRT (18 GA G-90 GALVANIZED METAL) USING .25" SELF DRILLING PAN HEAD SCREWS
- 1.5" WIDE FILLER STRIP MATERIAL (4MM LARSON ACM) USED TO COVER THE PANEL JOINTS, CUT AS REQUIRED.
- EXTRUDED ALUMINUM STARTER STRIP (6061 T6 ALUMINUM CUSTOM PROFILE) AT THE BASE AND ONE SIDE OF THE PANEL WALL.

*Note: The ACM used in the "EVO™ RIVETLESS™ Wall Panel System" is "larson by ALUCOIL" manufactured in Manning, South Carolina, USA. The larson® Aluminum Composite Material (ACM) utilized is a fully tested and certified, architectural wall cladding material available in both polyethylene (PE) and fire retardant (FR) core panels.*

**Test Backup Wall Construction:**

Specimen detail drawings have been removed from this page to protect proprietary information.  
Please contact the original report recipient for information pertaining to system details and assembly.

**Test Specimen Details:**

Specimen detail drawings have been removed from this page to protect proprietary information.  
Please contact the original report recipient for information pertaining to system details and assembly.

**Test Specimen Details:**

Specimen detail drawings have been removed from this page to protect proprietary information.  
Please contact the original report recipient for information pertaining to system details and assembly.

**APPENDIX B**

Specimen Construction Photographs

(2 Pages)



Figure B1 – Backup Wall Framing and Plexiglas Installation



Figure B2 – Lower Panel Installation



Figure B3 – Upper Panel Installation



Figure B4 – Completed Wall

## **APPENDIX C**

AAMA 501.1-05 Photographs (*Dynamic Pressure Test*)

(2 Pages)





Figure C1 - Specimen Set up in front of viewing chamber



Figure C2 - Spray rack Set up for water penetration



Figure C3 - Wind Machine setup to simulate Dynamic Pressure (AAMA 501.1-05)